



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,

Resident Engineer  
NESPAK  
Construction of 8-Lane Overhead Bridge at Imamia Colony

Reference # CED/TFL **4537** (Dr. M Kashif)  
Reference of the request letter # RE/4683/02/MH/181

Dated: 23-01-2024  
Dated: 01-01-2024

**Tension Test Report** (Page -1/4)

Date of Test 26-01-2024  
Gauge length 640 mm  
Description Steel Strand Tensile Test as per ASTM A-416-94a

Sr. No.	Nominal Diameter	Nominal Weight	Measured weight	Yield strength clause (6.3)		Breaking strength clause (6.2)		Young' s Modulus of Elasticity " E" GPa	% Elongation	Remarks / Coil No.
	(mm)	(kg/km)	(kg/km)	(kg)	(kN)	(kg)	(kN)			
1	12.70 (1/2")	780.0	785.0	18000	176.58	19600	192.28	199	>3.50	xx
2	12.70 (1/2")	780.0	782.0	17800	174.62	20100	197.18	199	>3.50	xx
3	12.70 (1/2")	780.0	783.0	18000	176.58	19700	193.26	199	>3.50	xx
-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	
<b>Only three samples for Test</b>										

Note:

1. Modulus of Elasticity is based on nominal steel area of the steel strand vide clause 13.3 of ASTM – A416a
2. Load versus percentage strain graphs are attached

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,

Resident Engineer  
NESPAK  
Construction of 8-Lane Overhead Bridge at Imamia Colony


Reference # CED/TFL 4537 (Dr. M Kashif)

Dated: 23-01-2024

Reference of the request letter # RE/4683/02/MH/181

Dated: 01-01-2024

**Graph** (Page – 2/4)

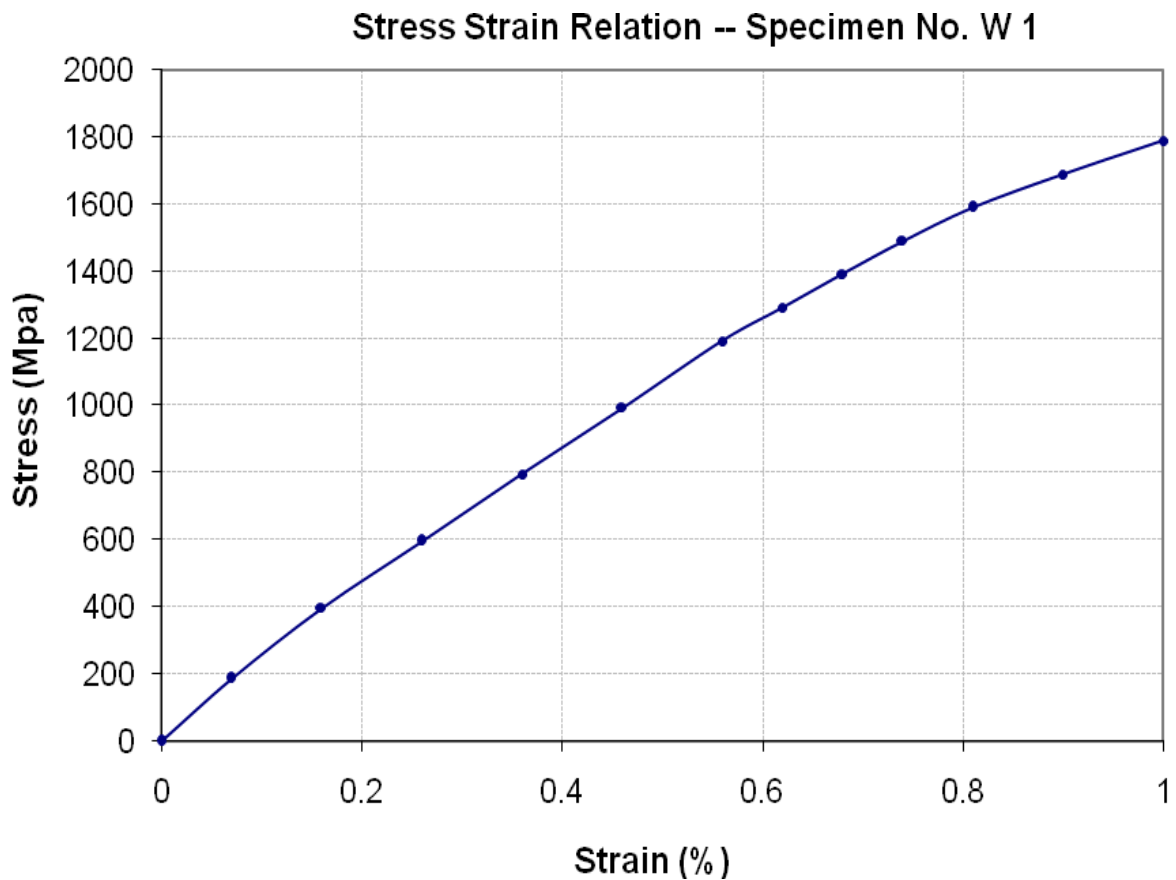

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**


To,

Resident Engineer  
NESPAK  
Construction of 8-Lane Overhead Bridge at Imamia Colony

Reference # CED/TFL 4537 (Dr. M Kashif)  
Reference of the request letter # RE/4683/02/MH/181

Dated: 23-01-2024  
Dated: 01-01-2024

**Graph** (Page – 3/4)

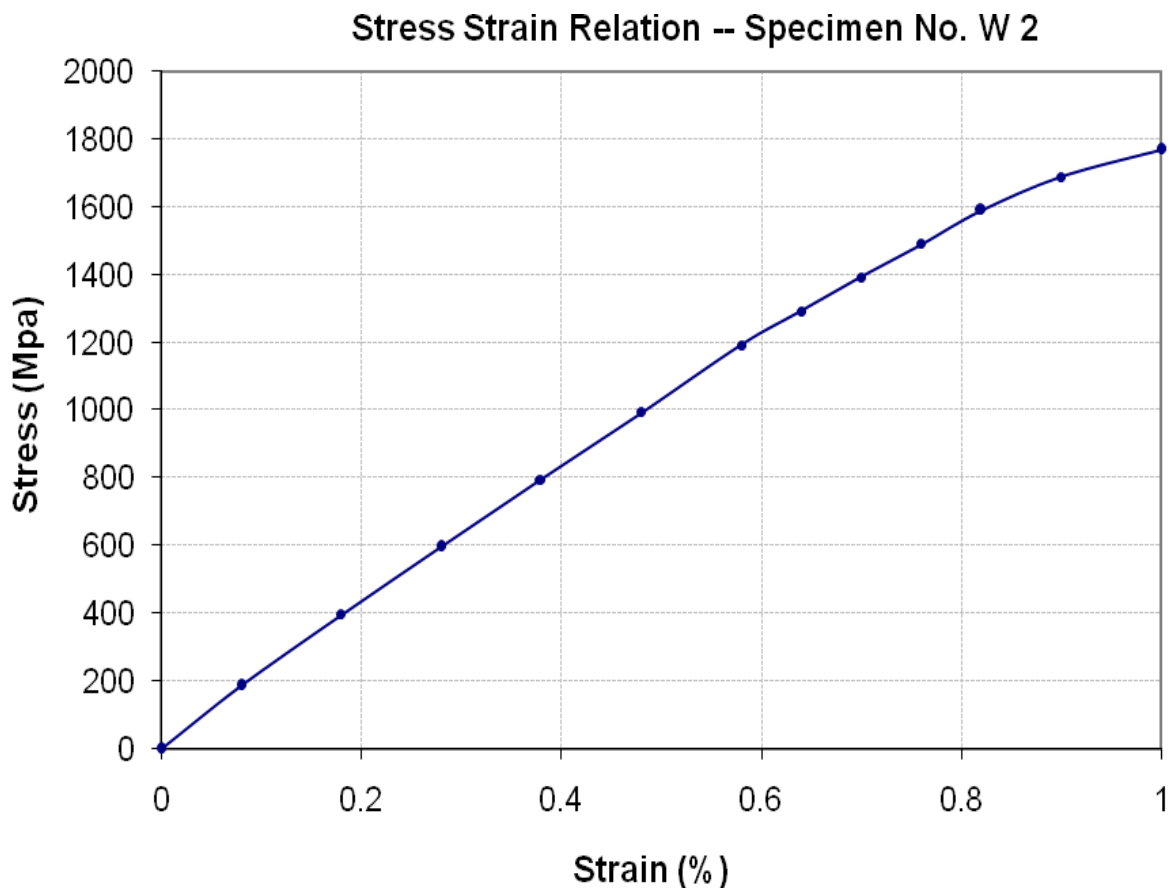

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**


To,

Resident Engineer  
NESPAK  
Construction of 8-Lane Overhead Bridge at Imamia Colony

Reference # CED/TFL 4537 (Dr. M Kashif)  
Reference of the request letter # RE/4683/02/MH/181

Dated: 23-01-2024  
Dated: 01-01-2024

**Graph** (Page – 4/4)

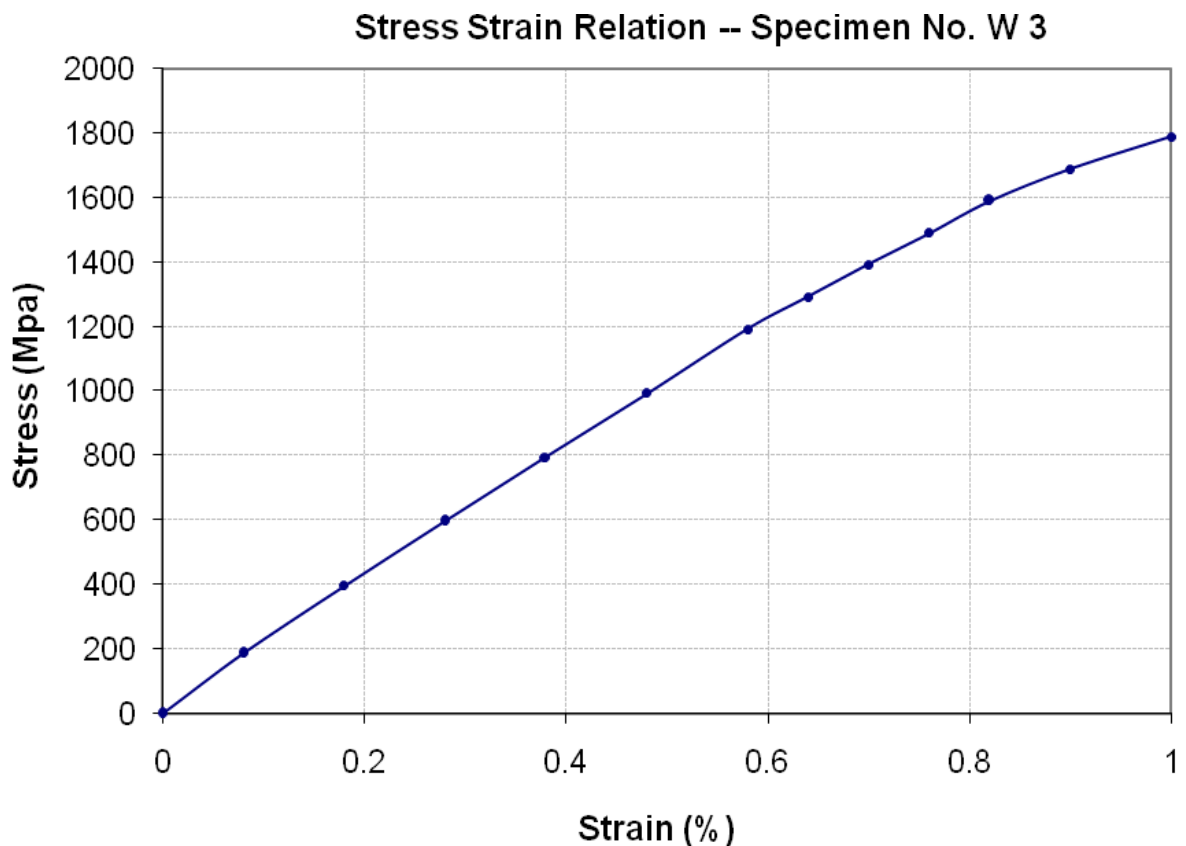

**I/C Testing Laboratories**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,

AGE (A) – II Gwa  
G.E (Army)-II  
Gujranwala Cantt  
“Const of Bldg No. 102 & 103 (VT-4 DLM Facility at 607 Regl EME Wksp at Gwa Cantt”

Reference # CED/TFL **4542** (Dr. M Kashif)  
Reference of the request letter # 6000-1130/7/E-6

Dated: 23-01-2024  
Dated: 16-01-2024

**Tension Test Report** (Page -1/1)

Date of Test 26-01-2024  
Gauge length 8 inches  
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight	Diameter/ Size (inch)		Area (in <sup>2</sup> )		Yield load	Breaking Load	Yield Stress (psi)		Ultimate Stress (psi)		Elongation	% Elongation	Remarks
	(lbs/ft)	Nominal	Actual	Nominal	Actual	(kg)	(kg)	Nominal	Actual	Nominal	Actual	(inch)		
1	0.397	3/8	0.385	0.11	0.117	4400	5200	88200	83180	104200	98300	0.80	10.0	
2	0.385	3/8	0.379	0.11	0.113	4400	5200	88200	85760	104200	101400	0.80	10.0	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
<b>Note: only two samples for tensile and one sample for bend test</b>														
Bend Test														
3/8" Dia Bar Bend Test Through 180° is Satisfactory														

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,

AGE (A) – II Gwa  
 G.E (Army)-II  
 Gujranwala Cantt

“Const of Engine Test Bench (VT-4 DLM Facility at 607 Regl EME Wksp at Gwa Cantt”

Reference # CED/TFL **4543** (Dr. M Kashif)

Dated: 23-01-2024

Reference of the request letter # 6000-1132/05/E-6

Dated: 16-01-2024

**Tension Test Report** (Page -1/1)

Date of Test 26-01-2024

Gauge length 8 inches

Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in <sup>2</sup> )		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.396	3/8	0.385	0.11	0.116	4300	5300	86200	81390	106200	100400	1.00	12.5	
2	0.391	3/8	0.382	0.11	0.115	4400	5300	88200	84470	106200	101800	0.80	10.0	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
<b>Note: only two samples for tensile and one sample for bend test</b>														
Bend Test														
3/8" Dia Bar Bend Test Through 180° is Satisfactory														

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,  
Executive Director  
Lahore Diocesan Board of Education  
St. Monic's High School, Clarkabad.

Reference # CED/TFL **4545** (Dr. M Kashif)  
Reference of the request letter # COORD/124/ /BLDG

Dated: 24-01-2024  
Dated: 22-01-2024

**Tension Test Report** (Page -1/1)

Date of Test 26-01-2024  
Gauge length 8 inches  
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in <sup>2</sup> )		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.370	3/8	0.372	0.11	0.109	3500	4900	70200	70960	98200	99400	1.40	17.5	
2	0.369	3/8	0.372	0.11	0.108	3500	4800	70200	71110	96200	97600	1.40	17.5	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
<b>Note: only two samples for tensile and one sample for bend test</b>														
Bend Test														
3/8" Dia Bar Bend Test Through 180° is Satisfactory														

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,  
 Principal  
 Centre of Excellence (Boys) School, Tandlianwala  
 (Construction of Boundary Wall)

Reference # CED/TFL **4547** (Dr. M Kashif)  
 Reference of the request letter # COEB/TW/ACCTS 653

Dated: 24-01-2024  
 Dated: 22-01-2024

**Tension Test Report** (Page -1/1)

Date of Test 26-01-2024  
 Gauge length 8 inches  
 Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in <sup>2</sup> )		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.377	3	0.376	0.11	0.111	3230	5010	64800	64250	100400	99700	1.20	15.0	Ravi Steel
2	0.378	3	0.376	0.11	0.111	3280	5010	65800	65120	100400	99500	1.00	12.5	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
<b>Note: only two samples for tensile and one sample for bend test</b>														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples





**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,

Sub Divisional Officer  
Buildings Sub Division No. 3  
Lahore  
(Revamping of Services Hospital Medical Block (Group-I))

Reference # CED/TFL **4548** (Dr. M Kashif)  
Reference of the request letter # 867

Dated: 24-01-2024  
Dated: 16-12-2023

**Tension Test Report** (Page -1/1)

Date of Test 26-01-2024  
Gauge length 8 inches  
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in <sup>2</sup> )		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.377	3	0.376	0.11	0.111	3640	4860	73000	72310	97400	96600	1.10	13.8	
2	0.375	3	0.375	0.11	0.110	3770	4940	75600	75320	99000	98700	1.10	13.8	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
<b>Note: only two samples for tensile and one sample for bend test</b>														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,

Resident Engineer  
 NESPAK

Dualization of Road from Mandi Baha-ud-Din to Sarai Alam Gir Canal Pull Main GT Road via Village Rasool District Mandi Baha-ud-Din (Length = 46 km).

Reference # CED/TFL **4549** (Dr. M Kashif)

Dated: 24-01-2024

Reference of the request letter # 4376-D/103/KT/03/267

Dated: 19-01-2024

**Tension Test Report** (Page -1/1)

Date of Test 26-01-2024

Gauge length 8 inches

Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in <sup>2</sup> )		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.372	3	0.373	0.11	0.109	3770	4840	75600	75970	97000	97600	1.00	12.5	Kamran Steel
2	0.372	3	0.373	0.11	0.109	3670	4840	73600	73950	97000	97600	1.20	15.0	
3	5.216	11	1.397	1.56	1.533	44600	66600	63100	64120	94100	95800	1.50	18.8	FF Steel
4	5.207	11	1.396	1.56	1.530	44800	66800	63300	64520	94400	96200	1.50	18.8	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
<b>Note: only four samples for tensile and two samples for bend test</b>														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														
#11 Bar Bend Test Through 180° is Satisfactory														

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,

Resident Engineer  
NESPAK

Dualization of Road from Mandi Baha-ud-Din to Sarai Alam Gir Canal Pull Main GT  
Road via Village Rasool District Mandi Baha-ud-Din (Length = 46 km) Section-1.  
(United Wire)

Reference # CED/TFL **4550** (Dr. M Kashif)

Dated: 24-01-2024

Reference of the request letter # 4376-D/103/KT/03/268

Dated: 19-01-2024

**Tension Test Report** (Page -1/2)

Date of Test 26-01-2024

Gauge length 640 mm

Description Steel Strand Tensile Test as per ASTM A-416-94a

Sr. No.	Nominal Diameter	Nominal Weight	Measured weight	Yield strength clause (6.3)		Breaking strength clause (6.2)		Young' s Modulus of Elasticity " E"	% Elongation	Remarks / Coil No.
	(mm)	(kg/km)	(kg/km)	(kg)	(kN)	(kg)	(kN)	GPa		
1	12.70 (1/2")	780.0	782.0	18000	176.58	20300	199.14	199	>3.50	xx
-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	
<b>Only one sample for Test</b>										

Note:

1. Modulus of Elasticity is based on nominal steel area of the steel strand vide clause 13.3 of ASTM – A416a
2. Load versus percentage strain graphs are attached

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,

Resident Engineer  
NESPAK

Dualization of Road from Mandi Baha-ud-Din to Sarai Alam Gir Canal Pull Main GT  
Road via Village Rasool District Mandi Baha-ud-Din (Length = 46 km) Section-1.  
(United Wire)


Reference # CED/TFL **4550** (Dr. M Kashif)

Dated: 24-01-2024

Reference of the request letter # 4376-D/103/KT/03/268

Dated: 19-01-2024

**Graph** (Page – 2/2)

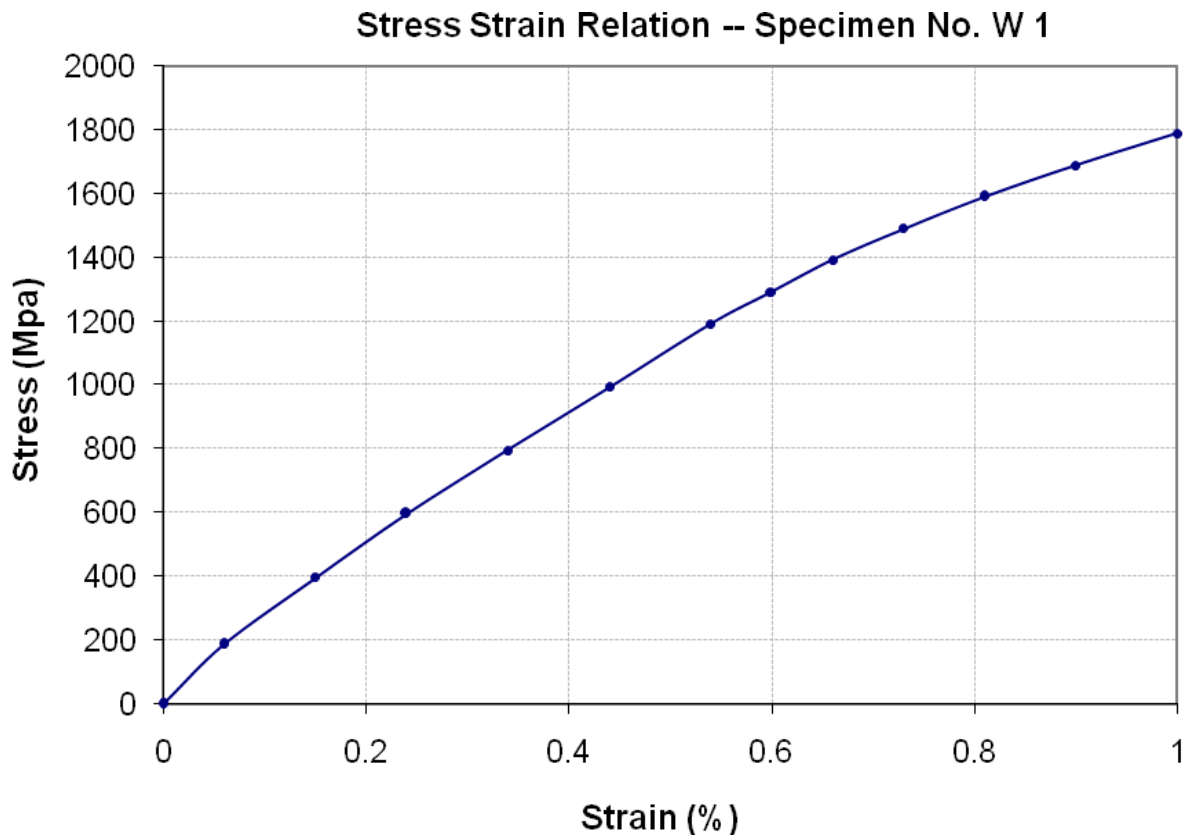

**I/C Testing Laboratories**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,

M/S Altec International  
Lahore

Reference # CED/TFL 4551 (Dr. M Kashif)  
Reference of the request letter # Nil

Dated: 24-01-2024

Dated: 24-01-2024

**Tension Test Report** (Page – 1/1)

Date of Test

26-01-2024

Description

Steel Wire Rope Tensile Test

Sr. No.	Nominal Diameter	Measured weight	Breaking Load	Remarks / Coil No.
	(mm)	(kg/m)	(kg)	
1	8.3	0.25	4400	
-	-	-	-	
-	-	-	-	
-	-	-	-	
-	-	-	-	
<b>Only one sample for Test</b>				

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,

Resident Engineer  
NESPAK  
Construction of 4-Lane Bridge Ravi River, Lahore.  
(Mughal Steel)

Reference # CED/TFL 4552 (Dr. M Kashif)

Dated: 25-01-2024

Reference of the request letter # 4537/03/MSA/09/184

Dated: 22-01-2024

**Tension Test Report** (Page -1/1)

Date of Test 26-01-2024

Gauge length 8 inches

Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in <sup>2</sup> )		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	4.137	10	1.244	1.27	1.216	39200	53800	68100	71050	93400	97600	1.40	17.5	F-041
2	4.137	10	1.244	1.27	1.216	40000	54000	69500	72500	93800	97900	1.50	18.8	F-042
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
<b>Note: only two samples for tensile and two samples for bend test</b>														
Bend Test														
#10 Bar Bend Test Through 180° is Satisfactory														
#10 Bar Bend Test Through 180° is Satisfactory														

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,

Assistant Resident Engineer  
 G3 Engineering Consultants (Pvt) Ltd.  
 Construction of Mian Gate along with Guard Rooms, Under Ground Sweet Water Tank  
 OHR with ½ Cusic Turbine and External Development Works for The Scheme  
 “Establishment of Sub Campus of GC University Faisalabad at Sammundari”.

Reference # CED/TFL **4554** (Dr. M Kashif)  
 Reference of the request letter # G3/GCUF/ARE/61

Dated: 25-01-2024  
 Dated: 19-12-2023

**Tension Test Report** (Page -1/1)

Date of Test 26-01-2024  
 Gauge length 8 inches  
 Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in <sup>2</sup> )		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.372	3	0.373	0.11	0.109	3570	4640	71600	71920	93000	93500	1.60	20.0	
2	0.373	3	0.374	0.11	0.110	3520	4660	70600	70710	93400	93600	1.60	20.0	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
<b>Note: only two samples for tensile and one sample for bend test</b>														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,

Director Projects  
Sheekhoo Sugar Mills (Steel Division)  
Anwar Abad Kot Addu, Muzaffargarh

Reference # CED/TFL **4558** (Dr. M Kashif)  
Reference of the request letter # Nil

Dated: 26-01-2024  
Dated: 22-01-2024

**Tension Test Report** (Page -1/1)

Date of Test 26-01-2024  
Gauge length 8 inches  
Description Deformed Steel Bar Tensile Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in <sup>2</sup> )		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.369	3	0.372	0.11	0.108	3500	5000	70200	71160	100200	101700	0.90	11.3	
2	0.368	3	0.371	0.11	0.108	3400	5000	68200	69360	100200	102000	1.50	18.8	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
<b>Note: only two samples for tensile test</b>														
Bend Test														

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples





**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,  
Resident Engineer  
Shahzad Ayub Associates (SAA)  
New Metro City Srailamgir

Reference # CED/TFL **4561** (Dr. M Kashif)  
Reference of the request letter # SAA-St-Rep-014

Dated: 26-01-2024  
Dated: 25-01-2024

**Tension Test Report** (Page -1/1)

Date of Test 26-01-2024  
Gauge length 8 inches  
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in <sup>2</sup> )		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.378	3	0.376	0.11	0.111	3620	5250	72600	71830	105200	104200	1.00	12.5	SJ Steel
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
<b>Note: only one sample for tensile and one sample for bend test</b>														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

**I/C Testing Laboratories**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples