



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
CEO
Faiq Construction Co.
Construction of Family Loft Apartments Lahore.

Reference # CED/TFL **5189** (Dr. Rizwan Azam)
Reference of the request letter # FCC/FLAT-JT/01/2024

Dated: 03-06-2024
Dated: 21-05-2024

Tension Test Report (Page -1/1)

Date of Test 05-06-2024
Gauge length 8 inches
Description Deformed Steel Bar Tensile Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.377	3/8	0.376	0.11	0.111	3800	5100	76200	75620	102200	101500	1.20	15.0	
2	0.376	3/8	0.375	0.11	0.111	3800	5100	76200	75690	102200	101600	1.10	13.8	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile test														
Bend Test														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
M/S Pakistan Wire Industries (Pvt) Limited
Karachi

Reference # CED/TFL **5192** (Dr. Rizwan Azam)
Reference of the request letter # WRD/010/LAB035

Dated: 03-06-2024
Dated: 03-06-2024

Tension Test Report (Page – 1/3)

Date of Test 05-06-2024
Description Steel Wire Rope (Jute Ungalvanized) Tensile Test

Sr. No.	Nominal Diameter	Measured weight	Breaking Load	Remarks / Coil No.
	(mm)	(kg/m)	(kg)	
1	12 (8x19)	0.48	7000	
-	-	-	-	
-	-	-	-	
-	-	-	-	
-	-	-	-	
Only one sample for Test				

Witness by Muhammad Wasim Khan (Pakistan Wire Industries)

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

M/S Pakistan Wire Industries (Pvt) Limited
Karachi

Reference # CED/TFL **5192** (Dr. Rizwan Azam)
Reference of the request letter # WRD/010/LAB036

Dated: 03-06-2024

Dated: 03-06-2024

Tension Test Report (Page – 2/3)

Date of Test

05-06-2024

Description

Steel Wire Rope (Sisal Ungalvanized) Tensile Test

Sr. No.	Nominal Diameter	Measured weight	Breaking Load	Remarks / Coil No.
	(mm)	(kg/m)	(kg)	
1	13 (8x19)	0.57	7200	
-	-	-	-	
-	-	-	-	
-	-	-	-	
-	-	-	-	
Only one sample for Test				

Witness by Muhammad Wasim Khan (Pakistan Wire Industries)

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

M/S Pakistan Wire Industries (Pvt) Limited
Karachi

Reference # CED/TFL **5192** (Dr. Rizwan Azam)
Reference of the request letter # WRD/010/LAB036

Dated: 03-06-2024

Dated: 03-06-2024

Tension Test Report (Page – 3/3)

Date of Test

05-06-2024

Description

Steel Wire Rope (Sisal Ungalvanized) Tensile Test

Sr. No.	Nominal Diameter	Measured weight	Breaking Load	Remarks / Coil No.
	(mm)	(kg/m)	(kg)	
1	14 (8x19)	0.64	7700	
-	-	-	-	
-	-	-	-	
-	-	-	-	
-	-	-	-	
Only one sample for Test				

Witness by Muhammad Wasim Khan (Pakistan Wire Industries)

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
M/S Pak Welding & Wear Solution
Lahore

Reference # CED/TFL **5193** (Dr. Rizwan Azam)
Reference of the request letter # Nil

Dated: 03-06-2024

Dated: 03-06-2024

Tension Test Report (Page – 1/1)

Date of Test 05-06-2024
Gauge length -----
Description Plain Steel Bar Weld Load Test

Sr. No.	Diameter Wire	Breaking Load	Remarks
	(mm)	(kg)	
1	10	2100	Weld Failure
-	-	-	-
-	-	-	-
-	-	-	-
-	-	-	-
-	-	-	-
-	-	-	-
-	-	-	-
Only one Sample for Test			

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
Project Manager
Innovative (R) Construction Company
“Allied Bank Sargodha”

Reference # CED/TFL **5198** (Dr. Rizwan Azam)
Reference of the request letter # ICL/ABL SGA

Dated: 04-06-2024
Dated: 04-06-2024

Tension Test Report (Page -1/1)

Date of Test 05-06-2024
Gauge length 8 inches
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.372	3	0.373	0.11	0.109	3700	4900	74200	74550	98200	98800	1.20	15.0	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only one sample for tensile and one samples for bend test														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
 Project Manager
 Innovative (R) Construction Company
 “Pepsi Co Phool Nagar”

Reference # CED/TFL **5199** (Dr. Rizwan Azam)
 Reference of the request letter # ICC/PCPN 01

Dated: 04-06-2024
 Dated: 04-06-2024

Tension Test Report (Page -1/1)

Date of Test 05-06-2024
 Gauge length 8 inches
 Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.373	3	0.374	0.11	0.110	3300	4700	66200	66260	94200	94400	1.40	17.5	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only one sample for tensile and one samples for bend test														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Sub Divisional Officer
Buildings Sub Division No. 15
Lahore
(Construction of Boundary Wall around The Land Transferred for Residences of High Court Officers and Officials at Phullarwan District Lahore.)

Reference # CED/TFL **5201** (Dr. Rizwan Azam)
Reference of the request letter # 724

Dated: 04-06-2024
Dated: 29-05-2024

Tension Test Report (Page -1/1)

Date of Test 05-06-2024
Gauge length 8 inches
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.368	3	0.371	0.11	0.108	3600	4900	72200	73370	98200	99900	1.10	13.8	
2	0.383	3	0.379	0.11	0.113	4100	5100	82200	80230	102200	99800	1.10	13.8	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one samples for bend test														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

M/S Ann Global Private Limited.
Gulberg-III, Lahore
(Manufacturing of PCC Poles at Sahiwal Pole Plant.)

Reference # CED/TFL **5202** (Dr. Safer Abbas)
Reference of the request letter # ANN/UET/2024-16

Dated: 04-06-2024
Dated: 28-05-2024

Tension Test Report (Page – 1/1)

Date of Test 05-06-2024
Gauge length 600 mm
Description Steel Strand Tensile Test as per ASTM A-416-94a

Sr. No.	Nominal Diameter	Nominal Weight	Measured weight	Yield strength clause (6.3)		Breaking strength clause (6.2)		% Elongation	Remarks / Coil No.
	(mm)	(kg/km)	(kg/km)	(kg)	(kN)	(kg)	(kN)		
1	9.53 (3/8")	430.0	442.0	9900	97.12	10900	106.93	>3.50	xx
-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	
Only one sample for Test									

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

M/S Amin Brothers Engineers Pak (Pvt) Ltd.
Gulberg-III, Lahore
(Manufacturing of PCC Poles at Jhang Pole Plant.)

Reference # CED/TFL **5203** (Dr. Safer Abbas)
Reference of the request letter # ABEL/UET/2024-05

Dated: 04-06-2024
Dated: 28-05-2024

Tension Test Report (Page – 1/1)

Date of Test 05-06-2024
Gauge length 600 mm
Description Steel Strand Tensile Test as per ASTM A-416-94a

Sr. No.	Nominal Diameter	Nominal Weight	Measured weight	Yield strength clause (6.3)		Breaking strength clause (6.2)		% Elongation	Remarks / Coil No.
	(mm)	(kg/km)	(kg/km)	(kg)	(kN)	(kg)	(kN)		
1	9.53 (3/8")	430.0	441.0	8400	82.40	10700	104.97	>3.50	xx
-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	
Only one sample for Test									

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Resident Engineer
NESPAK
Construction of Flyover at Shahdara Morr & Construction of Bridge over Ravi River,
Lahore. (Aziz Steel)

Reference # CED/TFL **5204** (Dr. Rizwan Azam)
Reference of the request letter # 4537/03/MSA/09/229

Dated: 04-06-2024
Dated: 20-05-2024

Tension Test Report (Page -1/1)

Date of Test 05-06-2024
Gauge length 8 inches
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Heat. No.
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.368	3	0.371	0.11	0.108	3200	5000	64200	65220	100200	101900	1.10	13.8	57
2	5.229	11	1.399	1.56	1.537	48000	66400	67900	68830	93900	95300	1.50	18.8	135
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Note: only three samples for tensile and three samples for bend test														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														
#11 Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
Project Manager
Sunshine Medical Tower Shashtra.

Reference # CED/TFL **5205** (Dr. Rizwan Azam)
Reference of the request letter # Nil

Dated: 04-06-2024
Dated: 04-06-2024

Tension Test Report (Page -1/1)

Date of Test 05-06-2024
Gauge length 8 inches
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.378	3	0.376	0.11	0.111	3400	4800	68200	67430	96200	95200	1.40	17.5	
2	0.375	3	0.375	0.11	0.110	3400	4900	68200	67910	98200	97900	1.60	20.0	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one samples for bend test														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Site Incharge
 Thaheem Construction Company
 Construction of CFPP MW Project at Sitara Chemical Industries, Faisalabad.

Reference # CED/TFL **5206** (Dr. Rizwan Azam)
 Reference of the request letter # TCC/UET/401

Dated: 04-06-2024
 Dated: 18-05-2024

Tension Test Report (Page -1/1)

Date of Test 05-06-2024
 Gauge length 8 inches
 Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (mm)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.410	10	9.95	0.12	0.120	4300	5600	78998	78680	102881	102500	1.20	15.0	
2	0.404	10	9.88	0.12	0.119	4300	5500	78998	79790	101044	102100	1.00	12.5	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one sample for bend test														
Bend Test														
10mm Dia Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Assistant Project Manager – Infra and EHS
Manven Projects LLP, Islamabad
NovaCare Hospital Private Limited DHA - Phase 5, Sector D.

Reference # CED/TFL **5209** (Dr. Safer Abbas)

Dated: 04-06-2024

Reference of the request letter # Maven/NovaCare/EPS/Strands/02

Dated: 30-05-2024

Tension Test Report (Page -1/2)

Date of Test 05-06-2024

Gauge length 600 mm

Description Steel Strand Tensile Test as per ASTM A-416-94a

Sr. No.	Nominal Diameter	Nominal Weight	Measured weight	Yield strength clause (6.3)		Breaking strength clause (6.2)		Young's Modulus of Elasticity "E"	% Elongation	Remarks / Coil No.
	(mm)	(kg/km)	(kg/km)	(kg)	(kN)	(kg)	(kN)	GPa		
1	12.70 (1/2")	780.0	782.0	17800	174.62	19600	192.28	199	>3.50	xx
-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	
Only one sample for Test										

Note:

1. Modulus of Elasticity is based on nominal steel area of the steel strand vide clause 13.3 of ASTM – A416a
2. Load versus percentage strain graphs are attached

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,


Assistant Project Manager – Infra and EHS
Manven Projects LLP, Islamabad
NovaCare Hospital Private Limited DHA - Phase 5, Sector D.

Reference # CED/TFL **5209** (Dr. Safer Abbas)

Dated: 04-06-2024

Reference of the request letter # Maven/NovaCare/EPS/Strands/02 Dated: 30-05-2024

Graph (Page – 2/2)

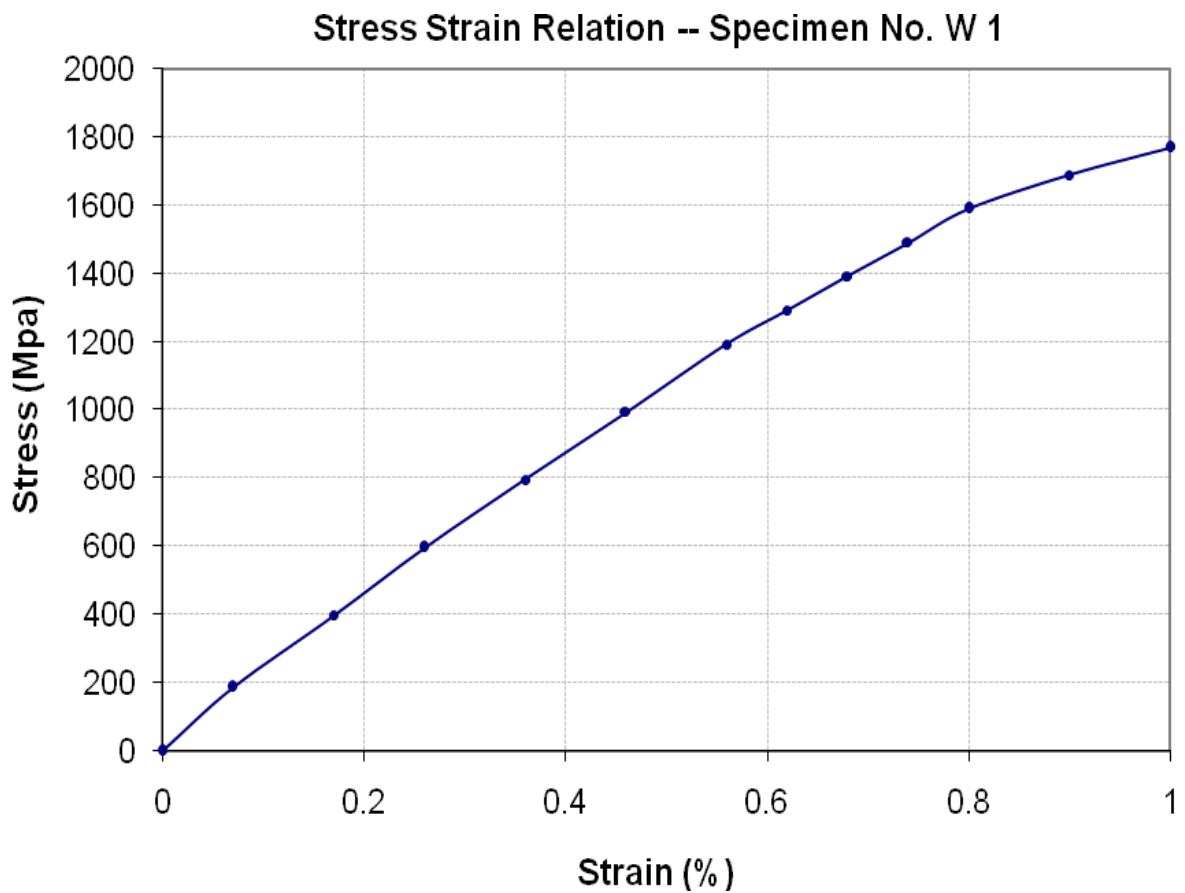

I/C Testing Laboratories
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
 Project Manager Civil
 Gulberg City Centre, Lahore
 Gulberg City Centre, Gulberg II 5 K, Lahore.

Reference # CED/TFL **5210** (Dr. Rizwan Azam)
 Reference of the request letter # Nil

Dated: 04-06-2024
 Dated: 04-06-2024

Tension Test Report (Page -1/1)

Date of Test 05-06-2024
 Gauge length 8 inches
 Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.366	3	0.370	0.11	0.108	3200	4300	64200	65510	86200	88100	1.00	12.5	
2	0.363	3	0.369	0.11	0.107	3500	4600	70200	72220	92200	95000	0.80	10.0	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one samples for bend test														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
Asst. Manager (Civil Inspections)
F & M
UCHS Hospital, Lahore

Reference # CED/TFL **5212** (Dr. Rizwan Azam)
Reference of the request letter # Nil

Dated: 04-06-2024
Dated: 04-06-2024

Tension Test Report (Page -1/1)

Date of Test 05-06-2024
Gauge length 8 inches
Description Deformed Steel Bar Tensile Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.406	3	0.390	0.11	0.119	3100	4900	62200	57220	98200	90500	1.30	16.3	
2	0.402	3	0.388	0.11	0.118	3100	4900	62200	57890	98200	91600	1.20	15.0	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile test														
Bend Test														

Witness by Umar Khayat (Assist Engineer - IDAP)

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Project Manager,
 HIGH-Q Constructions.
 Construction of HIGH-Q Mall at 3-A, GulbergII, Lahore.

Reference # CED/TFL **5214** (Dr. Rizwan Azam)
 Reference of the request letter # QC/HQ/CIVIL/214

Dated: 05-06-2024
 Dated: 05-06-2024

Tension Test Report (Page -1/1)

Date of Test 05-06-2024
 Gauge length 8 inches
 Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (mm)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.409	10	9.94	0.12	0.120	4000	5600	73487	73260	102881	102600	1.10	13.8	
2	0.406	10	9.90	0.12	0.119	4100	5600	75324	75790	102881	103600	1.10	13.8	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one sample for bend test														
Bend Test														
10mm Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Project Manager
 Amcorp Engineering & Construction (Pvt) Limited.
 Construction of ABL Upper Mall Lahore Plot No. 199, 200.

Reference # CED/TFL **5218** (Dr. Rizwan Azam)
 Reference of the request letter # ABL-UML-AMC-QAQC-82

Dated: 05-06-2024
 Dated: 05-06-2024

Tension Test Report (Page -1/1)

Date of Test 05-06-2024
 Gauge length 8 inches
 Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.425	3	0.399	0.11	0.125	4200	5600	84200	74050	112300	98800	1.00	12.5	FF Steel
2	0.415	3	0.394	0.11	0.122	3900	5200	78200	70490	104200	94000	0.80	10.0	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one sample for bend test														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples