



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

M/S Al-Abdullah Constructors (Pvt.) Ltd.
Karachi

Reference # CED/TFL **4820** (Dr. M Rizwan Riaz)
Reference of the request letter # Nil

Dated: 19-03-2024

Dated: 15-03-2024

Tension Test Report (Page -1/2)

Date of Test 25-03-2024
Gauge length 8 inches
Description MS Plain Wire Tensile Test

Sr. No.	Weight (kg/m)	Diameter/ size		Area (mm ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (MPa) Actual	Ultimate Stress (MPa) Actual	Elongation (inch)	% Elongation	Remarks
		Nominal (mm)	Actual (mm)	Nominal	Actual							
1	0.153	5	4.99	-----	19.5	1220	1550	613	779	0.40	5.0	
-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	
Note: only one sample for tensile test												
Bend Test												

I/C Testing Laboratories
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

M/S Al-Abdullah Constructors (Pvt.) Ltd.
Karachi

Reference # CED/TFL **4820** (Dr. M Rizwan Riaz)
Reference of the request letter # Nil

Dated: 19-03-2024

Dated: 15-03-2024

Tension Test Report (Page -2/2)

Date of Test 25-03-2024

Gauge length 640 mm

Description Steel Strand Tensile Test as per ASTM A-416-94a

Sr. No.	Nominal Diameter	Nominal Weight	Measured weight	Yield strength clause (6.3)		Breaking strength clause (6.2)		% Elongation	Remarks/ Coil No.
	(mm)	(kg/km)	(kg/km)	(kg)	(kN)	(kg)	(kN)		
1	9.53 (3/8")	432.0	427.0	5900	57.88	10700	104.97	>3.50	xx
-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-
Only two samples for Test									

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

Ref: CED/TFL/03/4849

Dated: 25-03-2024

Dated of Test: 02-04-2024

To

Deputy Director (QCD)
Water and Sanitation Agency
Faisalabd
(M/s Subhan RCC Pipe Manufacturing Factory Bhai Wala Phatak, Jhumra
Road Faisalabad)


Subject: - CALIBRATION OF HYDRAULIC JACK. (MARK: TFL/03/4849)

Reference to your Letter No. 88/DD(QCD)/WASA, Dated: 19/03/2024 on the subject cited above. One Hydraulic Jack with Gauge as received by us has been calibrated. The results are tabulated as under:

Total Range : Zero - 25 (Tonne)
Calibrated Range : Zero - 21 (Tonne)

Hydraulic Jack Reading (Tonne)	3	6	9	12	15	18	21	
Calibrated Load	(kg)	2600	5800	8800	11700	14450	17450	20100
	(Tonne)	2.60	5.80	8.80	11.70	14.45	17.45	20.10

1 Tonne = 1000 kg

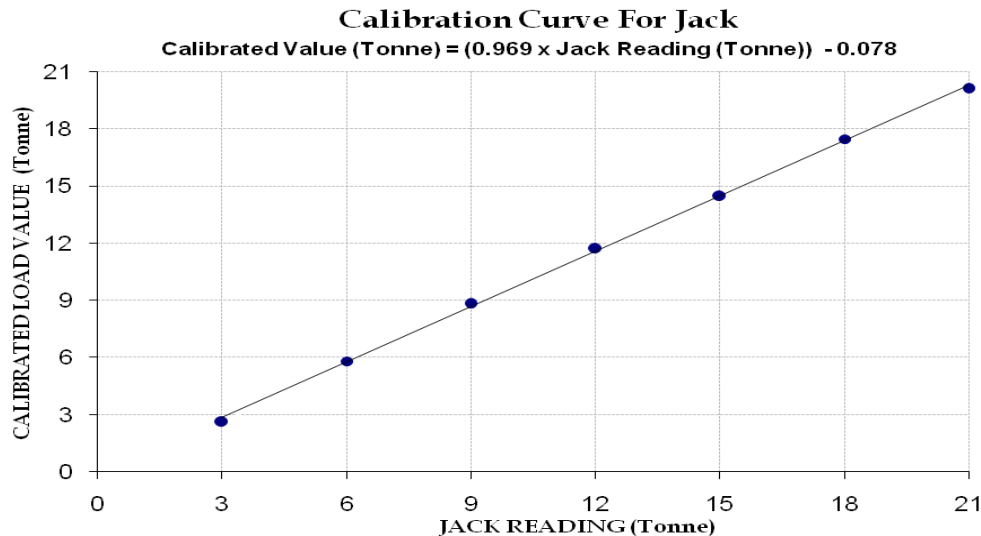

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Deputy Director (Tech-II)
EWR Phase-II
(Construction of Boundary Wall alongside The Fesco Colony and behind The
Encroachment Area and Fixing of Steel Grated Door at Project Site 229/RB, Faisalabad.)

Reference # CED/TFL **4837** (Dr. Rizwan Riaz)

Dated: 22-03-2024

Reference of the request letter # 366/DD(Tech-II)/EWR-II/2023

Dated: 27-12-2023

Tension Test Report (Page -1/1)

Date of Test 25-03-2024

Gauge length 8 inches

Description Deformed Steel Bar Tensile Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.381	3/8	0.378	0.11	0.112	4230	5300	84800	83230	106200	104300	1.00	12.5	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only one sample for tensile test														
Bend Test														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
Engineer
ATTA Tower, Ichra Ferozpur Road, Lahore

Reference # CED/TFL **4838** (Dr. M Rizwan Riaz)
Reference of the request letter # Nil

Dated: 22-03-2024
Dated: 22-03-2024

Tension Test Report (Page -1/1)

Date of Test 25-03-2024
Gauge length 8 inches
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.376	3	0.375	0.11	0.110	4100	5500	82200	81800	110200	109800	0.90	11.3	
2	0.364	3	0.369	0.11	0.107	3410	5050	68400	70260	101200	104100	1.20	15.0	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one sample for bend test														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratories
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Resident Engineer
G3 Engineering Consultant (Pvt) Ltd.
Consultancy Services for Master Planning Designing and Resident Type Supervision of
The Scheme Strengthening of University of Narowal.(Building IHS)

Reference # CED/TFL **4839** (Dr. Asad Ali)
Reference of the request letter # G3/237/RE/35

Dated: 22-03-2024
Dated: 29-01-2024

Tension Test Report (Page -1/1)

Date of Test 25-03-2024
Gauge length 8 inches
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.382	3	0.378	0.11	0.112	4130	5420	82800	81010	108600	106400	1.20	15.0	Kamran Steel
2	0.383	3	0.379	0.11	0.113	4130	5420	82800	80840	108600	106100	1.10	13.8	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one sample for bend test														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
Project Manager
REDO Engineering & Construction (Pvt) Limited.
BSP Workshop Kasur

Reference # CED/TFL **4840** (Dr. M Rizwan Riaz)
Reference of the request letter # QC/TST/2273-001

Dated: 22-03-2024
Dated: 22-03-2024

Tension Test Report (Page -1/1)

Date of Test 25-03-2024
Gauge length 8 inches
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.367	3	0.371	0.11	0.108	3690	5370	74000	75380	107600	109700	1.20	15.0	
2	0.358	3	0.366	0.11	0.105	3590	5250	72000	75220	105200	110000	1.30	16.3	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one sample for bend test														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratories
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Admin Manager
Linker Developers (Pvt) Ltd.
Construction of Quaid-e-Azam Public School Dream Garden Wazirabad.

Reference # CED/TFL **4843** (Dr. Asad Ali)
Reference of the request letter # Nil

Dated: 25-03-2024
Dated: 25-03-2024

Tension Test Report (Page -1/1)

Date of Test 25-02-2024
Gauge length 8 inches
Description Deformed Steel Bar Tensile Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks	
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual				
1	0.387	3	0.380	0.11	0.114	4280	5780	85800	83030	115900	112200	0.90	11.3	Markhor Steel	
2	0.377	3	0.376	0.11	0.111	4080	5350	81800	81100	107200	106400	0.90	11.3		
-	-	-	-	-	-	-	-	-	-	-	-	-	-		
-	-	-	-	-	-	-	-	-	-	-	-	-	-		
-	-	-	-	-	-	-	-	-	-	-	-	-	-		
-	-	-	-	-	-	-	-	-	-	-	-	-	-		
Note: only two samples for tensile test															
Bend Test															

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Unit Head PMO
ABL – UML P-199 & 200
Allied Bank
Construction of ABL Upper Mall Lahore Plot No. 199, 200.

Reference # CED/TFL **4845** (Dr. M Rizwan Riaz)
Reference of the request letter # ABL-UML-AMC-QAQC; 70

Dated: 25-03-2024
Dated: 25-03-2024

Tension Test Report (Page -1/1)

Date of Test 25-03-2024
Gauge length 8 inches
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.364	3	0.369	0.11	0.107	3590	5150	72000	73870	103200	106000	1.10	13.8	Markhor Steel
2	0.368	3	0.371	0.11	0.108	3820	5220	76600	77760	104600	106300	0.90	11.3	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one sample for bend test														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

I/C Testing Laboratories
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples