



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,  
M/S Global Dairy Tech  
Lahore

Reference # CED/TFL **37250** (Dr. M Rizwan Riaz)  
Reference of the request letter # Nil

Dated: 25-10-2021

Dated: 25-10-2021

**Tension Test Report** (Page -1/1)

Date of Test 26-10-2021  
Gauge length 8 inches  
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in <sup>2</sup> )		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.374	3/8	0.374	0.11	0.110	3500	4600	70200	70100	92200	92200	1.10	13.8	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
<b>Note: only one sample for tensile and one sample for bend test</b>														
Bend Test														
3/8" Dia Bar Bend Test Through 180° is Satisfactory														

**I/C Testing Laboratories**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,  
Resident Engineer  
Construction Supervision Consultants (CSC)  
CAREC – Regional Improving Border Services (RIBS) Project

Reference # CED/TFL **37251** (Dr. M Rizwan Riaz)

Dated: 25-10-2021

Reference of the request letter # 5065059/CAREC-RIBS/CHAMAN/RE-364 Dated: 20-10-2021

**Tension Test Report** (Page -1/2)

Date of Test 26-10-2021

Gauge length 640 mm

Description Steel Strand Tensile Test as per ASTM A-416-94a

Sr. No.	Nominal Diameter	Nominal Weight	Measured weight	Yield strength clause (6.3)		Breaking strength clause (6.2)		Young's Modulus of Elasticity "E"	% Elongation	Remarks / Coil No.
	(mm)	(kg/km)	(kg/km)	(kg)	(kN)	(kg)	(kN)	GPa		
1	12.70 (1/2")	775.0	787.0	17100	167.75	19500	191.30	199	>3.50	xx
-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-
<b>Only one sample for Test</b>										

Note:

1. Modulus of Elasticity is based on nominal steel area of the steel strand vide clause 13.3 of ASTM – A416a
2. Load versus percentage strain graphs are attached

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**


To,  
Resident Engineer  
Construction Supervision Consultants (CSC)  
CAREC – Regional Improving Border Services (RIBS) Project

Reference # CED/TFL **37251** (Dr. M Rizwan Riaz)

Dated: 25-10-2021

Reference of the request letter # 5065059/CAREC-RIBS/CHAMAN/RE-364 Dated: 20-10-2021

**Graph** (Page – 2/2)

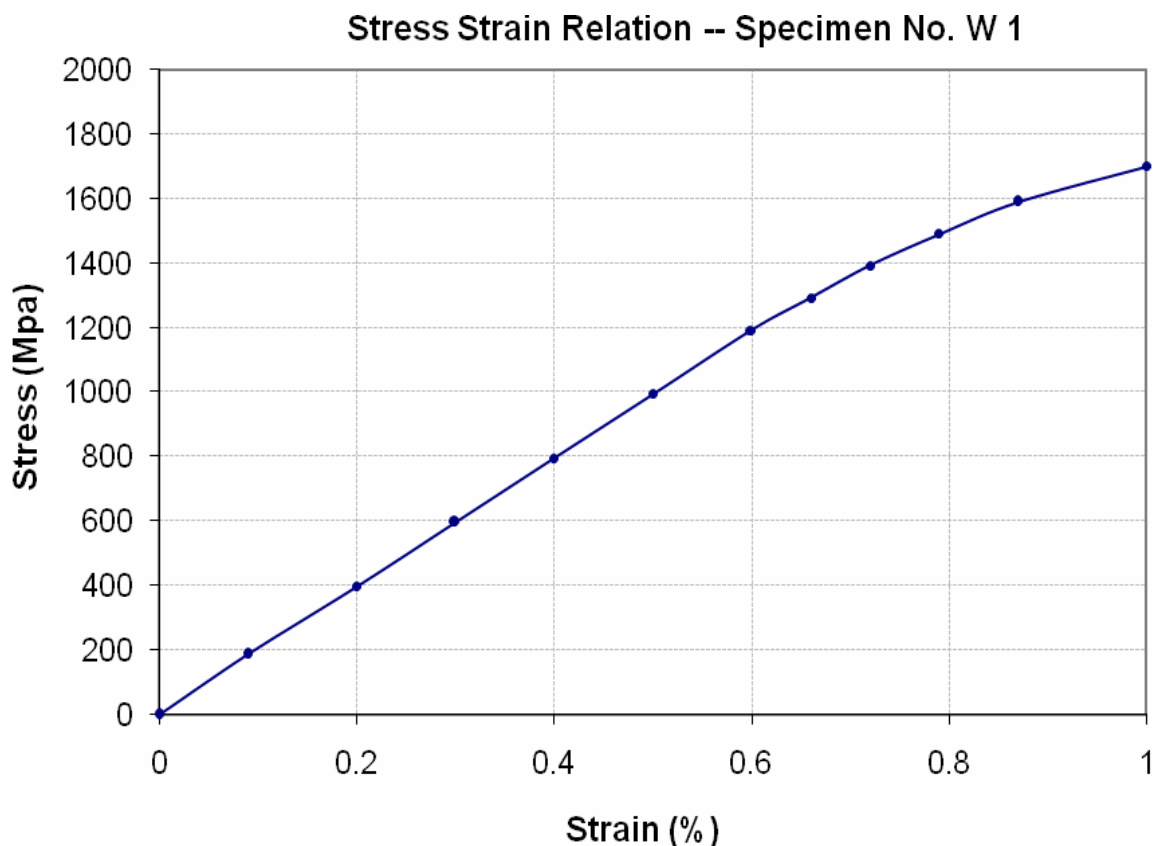

**I/C Testing Laboratories**  
**UET Lahore, Pakistan.**

**Note:**

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,  
 Project Manager  
 CM Engineering (Pvt) Ltd  
 Project Enfra Share Rollout Site ID: USKSK08, USKSK10, S-7442, S-7441, S-7443, S-7449, S-7448, S-7457  
 S-7438  
 Reference # CED/TFL **37252** (Dr. M Rizwan Riaz) Dated: 25-10-2021  
 Reference of the request letter # CME/Steel/Enfra Share Rollout/1000 Dated: 24-10-2021

**Tension Test Report** (Page -1/1)

Date of Test 26-10-2021  
 Gauge length 8 inches  
 Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (mm)		Area (in <sup>2</sup> )		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.374	10	9.51	0.12	0.110	3200	5100	58789	64110	93696	102200	1.30	16.3	
2	0.373	10	9.49	0.12	0.110	3200	5100	58789	64360	93696	102600	1.20	15.0	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
<b>Note: only two samples for tensile and one sample for bend test</b>														
Bend Test														
10mm Dia Bar Bend Test Through 180° is Satisfactory														

**I/C Testing Laboratoires**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

To,  
 Sub Divisional Officer  
 Highway Sub Division, DG Khan  
 (Construction of Metalled Road from Yaroo to Naow abad Length: 12.00 km District DG Khan  
 (Phase-I from km no. 8.80 to 8.90 km = 0.10 km (Part-B)

Reference # CED/TFL **37253** (Dr. M Rizwan Riaz)  
 Reference of the request letter # 2371

Dated: 25-10-2021  
 Dated: 27-08-2021

**Tension Test Report** (Page -1/1)

Date of Test 26-10-2021  
 Gauge length 8 inches  
 Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in <sup>2</sup> )		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.378	3	0.376	0.11	0.111	3400	5000	68200	67510	100200	99300	1.10	13.8	
2	0.376	3	0.375	0.11	0.111	3400	5000	68200	67780	100200	99700	1.30	16.3	
3	4.314	10	1.271	1.27	1.268	41600	56600	72200	72310	98300	98400	1.60	20.0	
4	4.294	10	1.268	1.27	1.262	40600	55600	70500	70900	96500	97100	1.80	22.5	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
<b>Note: only four samples for tensile and two samples for bend test</b>														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														
#10 Bar Bend Test Through 180° is Satisfactory														

**I/C Testing Laboratories**  
**UET Lahore, Pakistan.**

Note:

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



**STRUCTURAL ENGINEERING DIVISION**  
**Test Floor Laboratory**  
**Department of Civil Engineering**  
**University of Engineering and Technology Lahore, 54890**  
**Pakistan. Ph: 92-42-99029202**

**I/C Testing Laboratories**  
**UET Lahore, Pakistan.**

**Note:**

- 1- You can See your reports On Internet in the following web site  
[http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing\\_reports](http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports)
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples