



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Assistant Engineer Civil
 University of Home Economics Lahore
 “Construction of Academic Block at University of Home Economics Lahore”

Reference # CED/TFL **3419** (Dr. Rizwan Azam)
 Reference of the request letter # UHE/EC/1396

Dated: 09-06-2023
 Dated: 07-06-2023

Tension Test Report

Date of Test 12-06-2023
 Gauge length 8 inches
 Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.384	3/8	0.379	0.11	0.113	3400	4900	68200	66390	98200	95700	1.50	18.8	
2	0.383	3/8	0.379	0.11	0.113	3500	4900	70200	68540	98200	96000	1.50	18.8	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one sample for bend test														
Bend Test														
3/8" Dia Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratories
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

M/S Enplan Pvt Ltd
Faisal Town, Lahore.
(Construction of Corporat Tower at 15 Ali Block New Garden Town Lahore)
"14-04-2023"

Reference # CED/TFL **3421** (Dr. Rizwan Azam)
Reference of the request letter # Nil

Dated: 09-06-2023
Dated: 08-06-2023

Tension Test Report (Page # 1/2)

Date of Test 12-06-2023
Gauge length 8 inches
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.375	3/8	0.375	0.11	0.110	3400	4600	68200	67900	92200	91900	1.00	12.5	
2	0.374	3/8	0.374	0.11	0.110	3600	5000	72200	72090	100200	100200	1.10	13.8	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one sample for bend test														
Bend Test														
3/8" Dia Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratories
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

M/S Enplan Pvt Ltd
 Faisal Town, Lahore.
 (Construction of Corporat Tower at 15 Ali Block New Garden Town Lahore)
 “04-06-2023”

Reference # CED/TFL **3421** (Dr. Rizwan Azam)
 Reference of the request letter # Nil

Dated: 09-06-2023
 Dated: 08-06-2023

Tension Test Report (Page # 2/2)

Date of Test 12-06-2023
 Gauge length 8 inches
 Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.375	3/8	0.374	0.11	0.110	3900	5300	78200	78040	106200	106100	0.90	11.3	
2	0.380	3/8	0.377	0.11	0.112	3900	5400	78200	76970	108200	106600	0.90	11.3	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one sample for bend test														
Bend Test														
3/8" Dia Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
Head QA/QC
Al-A'Zamiyya Block Phase 1
Lahore.

Reference # CED/TFL **3422** (Dr. Rizwan Azam)
Reference of the request letter # Alz./ST/003

Dated: 09-06-2023
Dated: 09-06-2023

Tension Test Report

Date of Test 12-06-2023
Gauge length 8 inches
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.364	3	0.369	0.11	0.107	3800	4800	76200	78280	96200	98900	1.30	16.3	
2	0.361	3	0.367	0.11	0.106	3800	4900	76200	79010	98200	101900	1.20	15.0	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one sample for bend test														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
M/S ENAARA
Lahore

Reference # CED/TFL **3423** (Dr. M Rizwan Riaz)
Reference of the request letter # Nil

Dated: 09-06-2023
Dated: 09-06-2023

Tension Test Report (Page -1/1)

Date of Test 12-06-2023
Gauge length 8 inches
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks	
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual				
1	0.365	3	0.369	0.11	0.107	3100	4600	62200	63770	92200	94700	1.30	16.3	Batala Premium	
2	0.363	3	0.369	0.11	0.107	3100	4500	62200	63970	90200	92900	1.40	17.5		
-	-	-	-	-	-	-	-	-	-	-	-	-	-		
-	-	-	-	-	-	-	-	-	-	-	-	-	-		
-	-	-	-	-	-	-	-	-	-	-	-	-	-		
Note: only two samples for tensile and one sample for bend test															
Bend Test															
#3 Bar Bend Test Through 180° is Satisfactory															

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Assistant Resident Engineer
 JERS Consultancy (Pvt) Ltd
 PCP (Phase-II) Improvement and Construction of Roads in MC, Muridke.

Reference # CED/TFL **3424** (Dr. Rizwan Azam)

Dated: 09-06-2023

Reference of the request letter # 488-J01-ARE-2(MDK-P)/28

Dated: 04-06-2023

Tension Test Report

Date of Test 12-06-2023

Gauge length 8 inches

Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.361	3/8	0.368	0.11	0.106	3600	5000	72200	74770	100200	103900	0.90	11.3	Popular
2	0.351	3/8	0.362	0.11	0.103	3700	4900	74200	79030	98200	104700	0.80	10.0	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one sample for bend test														
Bend Test														
3/8" Dia Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Sub Divisional Officer
Link Canal sub Division
Farooqabad
(Construction of New Q.B. Link Office Complex, Residences and Boundary Wall at Farooqabad)

Reference # CE3432D/TFL **3425** (Dr. Rizwan Azam)
Reference of the request letter # 115/1-W

Dated: 09-06-2023
Dated: 06-06-2023

Tension Test Report (Page -1/1)

Date of Test 12-06-2023

Gauge length 8 inches

Description Deformed Steel Bar Tensile Test as per ASTM-A615

Sr. No.	Weight	Diameter/ Size		Area (in ²)		Yield load	Breaking Load	Yield Stress (psi)		Ultimate Stress (psi)		Elongation	% Elongation	Remarks
	(lbs/ft)	Nominal (#)	Actual (inch)	Nominal	Actual	(kg)	(kg)	Nominal	Actual	Nominal	Actual	(inch)		
1	0.378	3	0.376	0.11	0.111	2600	4200	52100	51580	84200	83400	1.50	18.8	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only one sample for tensile test														
Bend Test														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Engr. Dahiya Qalbi
 Site Engineer
 200 Elementary School Building Lahore American School, Upper Mall Road Lahore.

Reference # CED/TFL **3427** (Dr. Rizwan Azam)
 Reference of the request letter # Nil

Dated: 09-06-2023
 Dated: 09-06-2023

Tension Test Report

Date of Test 12-06-2023
 Gauge length 8 inches
 Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal (#)	Actual (inch)	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.381	3	0.378	0.11	0.112	3400	5300	68200	66880	106200	104300	1.10	13.8	
2	0.383	3	0.379	0.11	0.113	3500	5300	70200	68560	106200	103900	1.40	17.5	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one sample for bend test														
Bend Test														
#3 Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Resident Engineer
PEAS Consulting Islamabad
Construction Supervision of Underpass / Bidge over Soan River & Link road fom DHA-1
to N-5 (SOS Village) Rawalpindi.

Reference # CED/TFL **3428** (Dr. Rizwan Azam)

Dated: 09-06-2023

Reference of the request letter # PEAS/DHA/SOAN/55

Dated: 08-06-2023

Tension Test Report (Page -1/2)

Date of Test 12-06-2023

Gauge length 640 mm

Description Steel Strand Tensile Test as per ASTM A-416-94a

Sr. No.	Nominal Diameter	Nominal Weight	Measured weight	Yield strength clause (6.3)		Breaking strength clause (6.2)		Young's Modulus of Elasticity "E"	% Elongation	Remarks / Coil No.
	(mm)	(kg/km)	(kg/km)	(kg)	(kN)	(kg)	(kN)	GPa		
1	12.70 (1/2")	775.0	792.0	18600	182.47	20200	198.16	199	>3.50	xx
-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	
Only one sample for Test										

Note:

1. Modulus of Elasticity is based on nominal steel area of the steel strand vide clause 13.3 of ASTM – A416a
2. Load versus percentage strain graphs are attached

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Resident Engineer
PEAS Consulting Islamabad
Construction Supervision of Underpass / Bidge over Soan River & Link road fom DHA-1
to N-5 (SOS Village) Rawalpindi.


Reference # CED/TFL **3428** (Dr. Rizwan Azam)

Dated: 09-06-2023

Reference of the request letter # PEAS/DHA/SOAN/55

Dated: 08-06-2023

Graph (Page – 2/2)

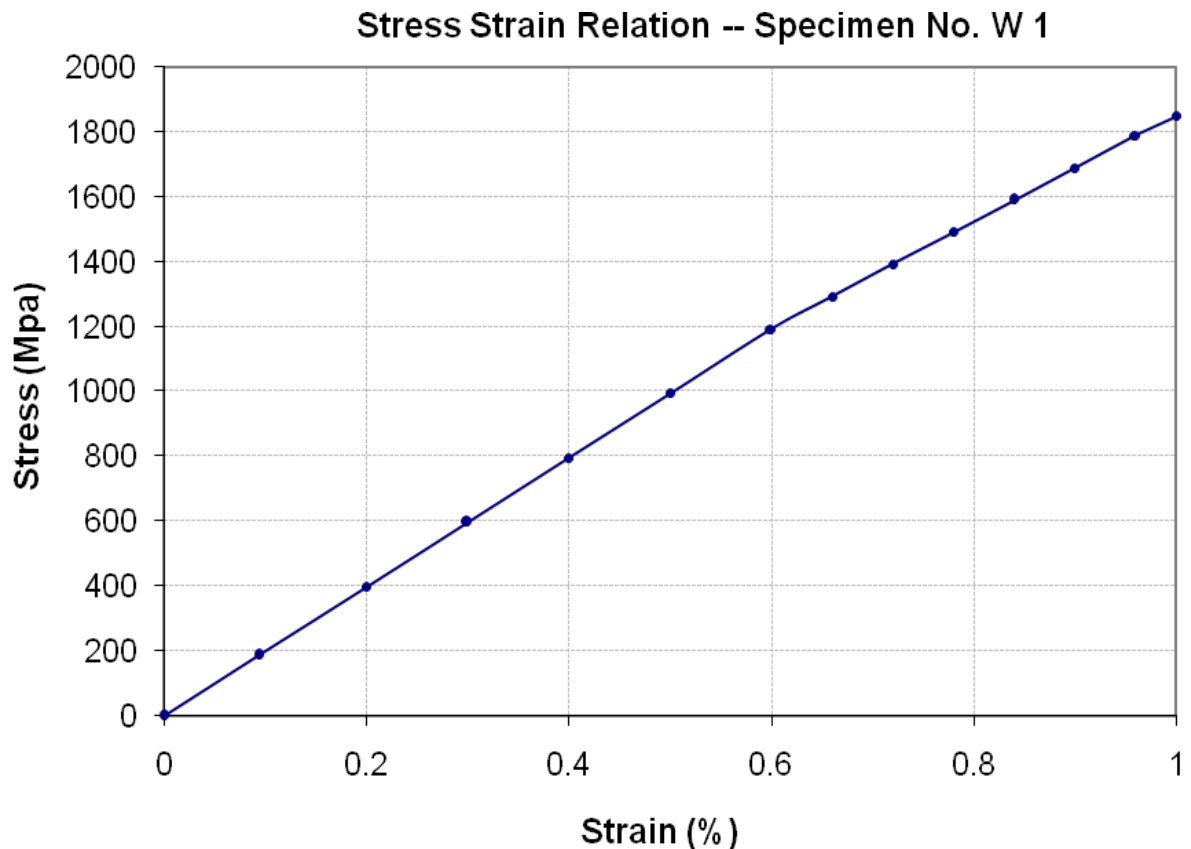

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
M/S Noor Muhammad & Sons
Circular Road, Gujranwala

Reference # CED/TFL **3429** (Dr. Rizwan Azam)
Reference of the request letter # Nil

Dated: 09-06-2023
Dated: 04-06-2023

Tension Test Report (Page -1/1)

Date of Test 12-06-2023
Gauge length 8 inches
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.371	3/8	0.372	0.11	0.109	3100	4500	62200	62740	90200	91100	1.30	16.3	Sheikhoo Steel
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only one sample for tensile and one sample for bend test														
Bend Test														
3/8" Dia Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

M/S Al Rasheed Traders
Khushab Road, Sargodha

Reference # CED/TFL **3430** (Dr. Rizwan Azam)
Reference of the request letter # Nil

Dated: 09-06-2023

Dated: 05-06-2023

Tension Test Report (Page -1/1)

Date of Test 12-06-2023

Gauge length 8 inches

Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.371	3/8	0.372	0.11	0.109	3300	4700	66200	66790	94200	95200	1.40	17.5	Sheikhoo Steel
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only one sample for tensile and one sample for bend test														
Bend Test														
3/8" Dia Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratories
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
M/S Arif Mughal Traders
Narowal

Reference # CED/TFL **3431** (Dr. Rizwan Azam)
Reference of the request letter # Nil

Dated: 09-06-2023
Dated: 05-06-2023

Tension Test Report (Page -1/1)

Date of Test 12-06-2023
Gauge length 8 inches
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.372	3/8	0.373	0.11	0.109	3300	4700	66200	66460	94200	94700	1.40	17.5	Sheikhoo Steel
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only one sample for tensile and one sample for bend test														
Bend Test														
3/8" Dia Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
M/S Madina Iron Store
Faisalabad Bypass Road, Sheikhpura

Reference # CED/TFL **3432** (Dr. Rizwan Azam)
Reference of the request letter # Nil

Dated: 09-06-2023
Dated: 05-06-2023

Tension Test Report (Page -1/1)

Date of Test 12-06-2023
Gauge length 8 inches
Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks	
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual				
1	0.374	3/8	0.374	0.11	0.110	3300	4700	66200	66150	94200	94300	1.30	16.3	Sheikhoo Steel	
-	-	-	-	-	-	-	-	-	-	-	-	-	-		
-	-	-	-	-	-	-	-	-	-	-	-	-	-		
-	-	-	-	-	-	-	-	-	-	-	-	-	-		
-	-	-	-	-	-	-	-	-	-	-	-	-	-		
-	-	-	-	-	-	-	-	-	-	-	-	-	-		
Note: only one sample for tensile and one sample for bend test															
Bend Test															
3/8" Dia Bar Bend Test Through 180° is Satisfactory															

I/C Testing Laboratories
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
- 2- The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
 M/S Super Sheikh Iron Store
 Faisalabad Road, Jhang Cantt

Reference # CE3432D/TFL **3433** (Dr. Rizwan Azam)
 Reference of the request letter # Nil

Dated: 09-06-2023
 Dated: 09-04-2023

Tension Test Report (Page -1/1)

Date of Test 12-06-2023
 Gauge length 8 inches
 Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.367	3/8	0.371	0.11	0.108	3200	4700	64200	65400	94200	96100	1.40	17.5	Sheikhoo Steel
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only one sample for tensile and one sample for bend test														
Bend Test														
3/8" Dia Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,

Resident Engineer
 G3 Engineering Consultants (Pvt) Ltd.
 Construction of Residential Area (G20, G-18-19, Family Flats, Male & Female Faculty Hostel, Guest House & Masjid) at University of Narowal (New Campus) against the Project "Strengthening & Expansion of University of Gujrat & Allied Campus (Narowal ComponentP"

Reference # CED/TFL **3434** (Dr. Rizwan Azam)
 Reference of the request letter # G3/UON-RE/304

Dated: 09-06-2023

Dated: 29-05-2023

Tension Test Report

Date of Test 12-06-2023

Gauge length 8 inches

Description Deformed Steel Bar Tensile and Bend Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (inch)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	0.390	3/8	0.382	0.11	0.115	3000	4900	60200	57750	98200	94400	1.30	16.3	
2	0.396	3/8	0.385	0.11	0.116	3300	5000	66200	62490	100200	94700	1.30	16.3	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only two samples for tensile and one sample for bend test														
Bend Test														
3/8" Dia Bar Bend Test Through 180° is Satisfactory														

I/C Testing Laboratoires
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples



STRUCTURAL ENGINEERING DIVISION
Test Floor Laboratory
Department of Civil Engineering
University of Engineering and Technology Lahore, 54890
Pakistan. Ph: 92-42-99029202

To,
 Dr. Sajjad Ahmed
 CED, BZU, Multan

Reference # CED/TFL **3436** (Dr. Rizwan Azam)
 Reference of the request letter # Nil

Dated: 12-06-2023
 Dated: 12-06-2023

Tension Test Report (Page -1/1)

Date of Test 12-06-2023
 Gauge length 8 inches
 Description Deformed Steel Bar Tensile Test as per ASTM-A615

Sr. No.	Weight (lbs/ft)	Diameter/ Size (mm)		Area (in ²)		Yield load (kg)	Breaking Load (kg)	Yield Stress (psi)		Ultimate Stress (psi)		Elongation (inch)	% Elongation	Remarks
		Nominal	Actual	Nominal	Actual			Nominal	Actual	Nominal	Actual			
1	3.391	32	28.61	1.25	0.997	-----	30600	-----	-----	53969	67700	1.50	18.8	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Note: only one sample for tensile test														
Bend Test														

I/C Testing Laboratories
UET Lahore, Pakistan.

Note:

- 1- You can See your reports On Internet in the following web site
http://www.uet.edu.pk/faculties/facultiesinfo/civil/index.html?RID=testing_reports
2. The above results pertain to sample /samples supplied to this laboratory.
- 3- Sealed sample / Unsealed sample / Marked sample/Signed Samples